


## Facility Management

# Application

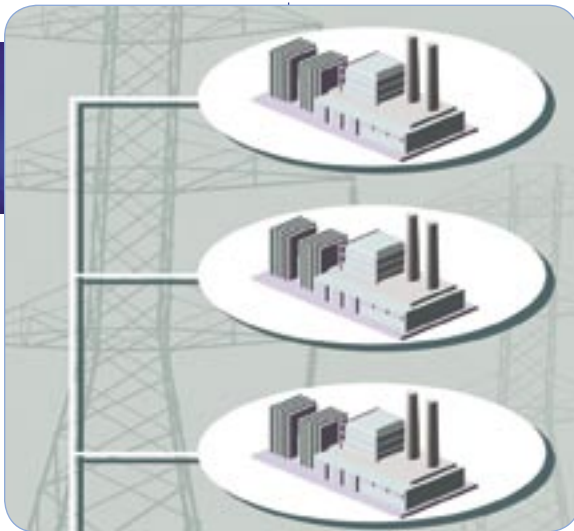

- Office Complexes
- Sports Facilities
- Hotels
- Airports
- Departments
  - Facilities Engineering
  - Maintenance Engineering

### Overview

Large facilities use a lot of energy to run equipment, fans, pumps, motors, heaters, lights, and air conditioners. By efficient use of this equipment, the amount of energy used by the facility can be significantly reduced.

### Challenge

The efficient management of lights, heating, air conditioning, ventilation, and even security systems requires equipment that is accurate and reliable. The equipment must be able to interface with a variety of transducers and control an array of other equipment.

### Solution

A VXIbus data acquisition and control system from VXI Technology has the speed, intelligence, reliability, and point count needed to monitor either small or large facilities and still reduce operating costs. When sufficient data is gathered, the data acquisition system can be expanded to control equipment such as fans, blowers, pumps, and lights. By making accurate measurements and timely decisions, the cost of electricity and natural gas can be reduced by an amount which can pay for the entire data acquisition system in less than a year.

### Implementation

#### Air Temperature

Temperatures at various points in the facility are monitored continuously to provide comfortable room temperatures. Warm or cool air can be moved throughout the facility to areas that need it. Monitoring outside temperatures can ensure that air brought into the building is heated or cooled only as needed. Thermistors are used to measure temperature when accuracy is critical. Thermocouples are used for higher temperatures and for low cost general monitoring.

## Facility Management

### Lighting Control

Lights in the facility can be turned on and off during the day depending on work schedules. Holidays and weekends can be set for different schedules. Parking lot lights can also be turned on or off based on hours of daylight. An override system allows people in the facilities to keep their lights on when working early or late.

### Power Usage Monitoring

Most large facilities use commercial electricity to run compressors, fans, and large machinery. Power meters can be installed throughout the facility and monitored by counters to determine the power used by different departments. The energy rate for the facility is determined by peak loads during the daytime hours. By monitoring the power to these machines and shutting down non-essential loads (load shedding), the facility can lower its peak power usage and thus its electricity bill. The speed of these parts can affect appliance efficiency and the lifetime of its parts. Pulse output transducers are typically used to measure rotational speed.

### Air Pressure

Air is circulated in and out of a building to maintain a comfortable working environment. In large facilities, uneven air flow can cause "wind tunnel" effects in hallways and stairwells. Pressure transducers monitor the pressure differences around the facility. To maintain proper pressures, fans and vents can be regulated by the data acquisition system.



### Water Temperature/Pressure

Water temperatures can be monitored in large facilities to regulate building heat, swimming pool temperatures, or to prevent boiling in the pipes in high rise structures at high elevations. When used in conjunction with pressure, water temperature can be regulated throughout the facility to reduce waste and, therefore, costs.

### Other Systems

Other systems such as security alarms, lawn sprinklers, solar panels, and heat pumps can all be monitored and/or controlled by the data acquisition system. Accurate control of these systems can reduce energy costs.

### Key System Features

VXIbus open architecture  
 Data Acquisition and Control on a single programmable VXIbus card (VT1419A)  
 Graphical programming language (Agilent VEE or NI Labview)  
 Flexibility with deterministic control  
 Wide choice of inputs/outputs  
 Built-in control algorithms  
 Up to 32 user-written "C" code algorithms  
 65,000 reading FIFO buffer  
 500 reading Current Value Table (CVT)  
 All algorithms can write to FIFO/CVT  
 Data can be time-stamped

### Typical Configuration

Data Acquisition System	Quantity
CT-100C VXI 6-Slot Card Cage	1
FireWire VXI Slot 0 Command Module	1
VT1419A Multifunction Measurement & Control Card	1-3
Analog input channels (VT1501A)	20-100
Counter channels (VT1538A)	5-10
Voltage DAC channels (VT1531A)	5-25
Digital input channels (VT1533A)	10-50
Digital output channels (VT1533A)	26-62